

BOARD OF PUBLIC WORKS  
MEMBERS

AURA GARCIA  
PRESIDENT

M. TERESA VILLEGAS  
VICE PRESIDENT

DR. MICHAEL R. DAVIS  
PRESIDENT PRO TEMPORE

VAHID KHORSAND  
COMMISSIONER

SUSANA REYES  
COMMISSIONER

TJ KNIGHT  
ACTING EXECUTIVE OFFICER

# CITY OF LOS ANGELES

CALIFORNIA



KAREN BASS  
MAYOR

DEPARTMENT OF  
PUBLIC WORKS

BUREAU OF  
ENGINEERING

TED ALLEN, PE  
CITY ENGINEER

1149 S. BROADWAY, SUITE 700  
LOS ANGELES, CA 90015-2213

<http://eng.lacity.org>

September 16, 2024

David Savant  
West Coast Regional Manager  
EJ Company  
2577 E 79<sup>th</sup> Avenue  
Denver, Colorado 80229-6108

**SUBJECT: APPROVAL OF EJ COMPANY 3510Z-3510C 11-1/2" CAST IRON CHIMNEY COVER ASSEMBLY (BD002558)**

Dear Mr. Savant:

The above listed product (11-1/2" cast iron chimney cover assembly) has been granted approval for Citywide Use in the public right of way for buried applications only, effective September 16, 2024. This approval will expire on September 16, 2026. Six months before this approval expires, you may apply for a two-year extension. Maximum total duration of approvals (with extensions) is eight years. At that time, this product must be resubmitted for a new approval. This cover assembly shall be a buried sewer cover, similar to City Standard Plan S-160 as modified to the conditions below.

Approval Conditions:

1. BOE CM/PM to verify size of the cover and access clearance with their project details
2. Cover assembly must be buried at least 18-inches below the street finished surface
3. Cover assembly must be encased in structural concrete per attached exhibit #1 unless specified differently in BOE project drawings
4. LASAN approval required to be used as a buried cover

The City assumes no responsibility for any and all safety related issues in regard to the installation and use of this product. It is the responsibility of the installer to understand the appropriate use and limitations of this product and to address any and all safety concerns with the manufacturer. Further, it is the installer's responsibility to conform to all applicable industry and regulatory safety requirements.

Please be advised that you are required to report any changes in material or geometry of this product to the City immediately and to recertify this product before it expires. A permit is required for the installation as this product is subject to site and fabrication inspections per Subsection 3-5 and Section 4 of the Standard Specifications for Public Works Construction (SSPWC) as amended by the Brown Book.


Please contact the Material Control Section of the Bureau of Contract Administration at 213-485-5080 to arrange for fabrication inspection. Please maintain a copy of this approval for your record and distribute a copy to the Contractor for use in the field or for the permit process. If you have any questions, please contact Thomas Woo at [thomas.woo@lacity.org](mailto:thomas.woo@lacity.org) or (Alan) Chiu Tam at [chiu.tam@lacity.org](mailto:chiu.tam@lacity.org).

Sincerely,

(Alan) Chiu Tam, S.E., LEED AP  
Senior Structural Engineer  
Wastewater Conveyance Engineering Division  
Bureau of Engineering

Attachment: Approved submittal for chimney cover assembly and exhibit #1  
CC: Jerry S Harris - [Jerry.simpson-harris@lacity.org](mailto:Jerry.simpson-harris@lacity.org), (Bureau of Contract Administration – Materials Control)



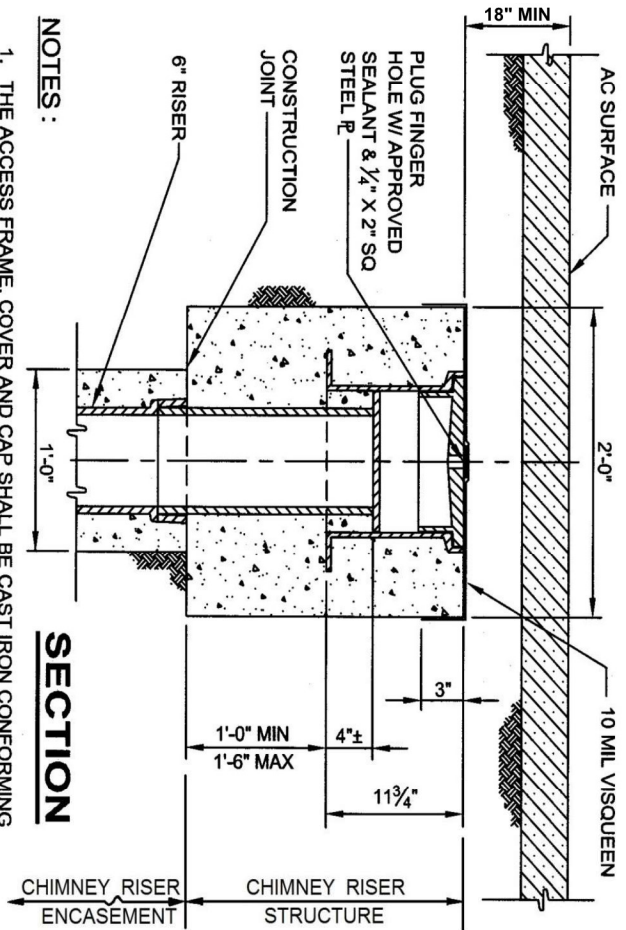

**NOTES:**

1. THE ACCESS FRAME, COVER AND CAP SHALL BE CAST IRON CONFORMING TO SECTION 206-3 OF THE STANDARD SPECIFICATIONS. THE FINGER HOLES MAY BE DRILLED OUT PRIOR TO CASTING; THEY SHALL NOT BE PUNCHED OUT.
2. SEE STANDARD PLAN S-164 FOR ACCESS FRAME, COVER & CAP DIMENSIONS AND LETTERING REQUIREMENTS.
3. CONCRETE FOR ENCASEMENT AND WALL SUPPORT FOR PIPES AND FITTINGS SHALL BE PLACED UNIFORMLY AROUND THE PIPES AND FITTINGS AS SHOWN HEREON TO MAINTAIN PROPER ALIGNMENT, AND SHALL BE CLASS 420-C-2000.

**SECTION**

SUBJECT: APPROVAL OF EJ COMPANY 3510Z-3510C 11-1/2" CAST IRON CHIMNEY COVER ASSEMBLY (BD002558)

**EXHIBIT #1**