


**PLAN VIEW**

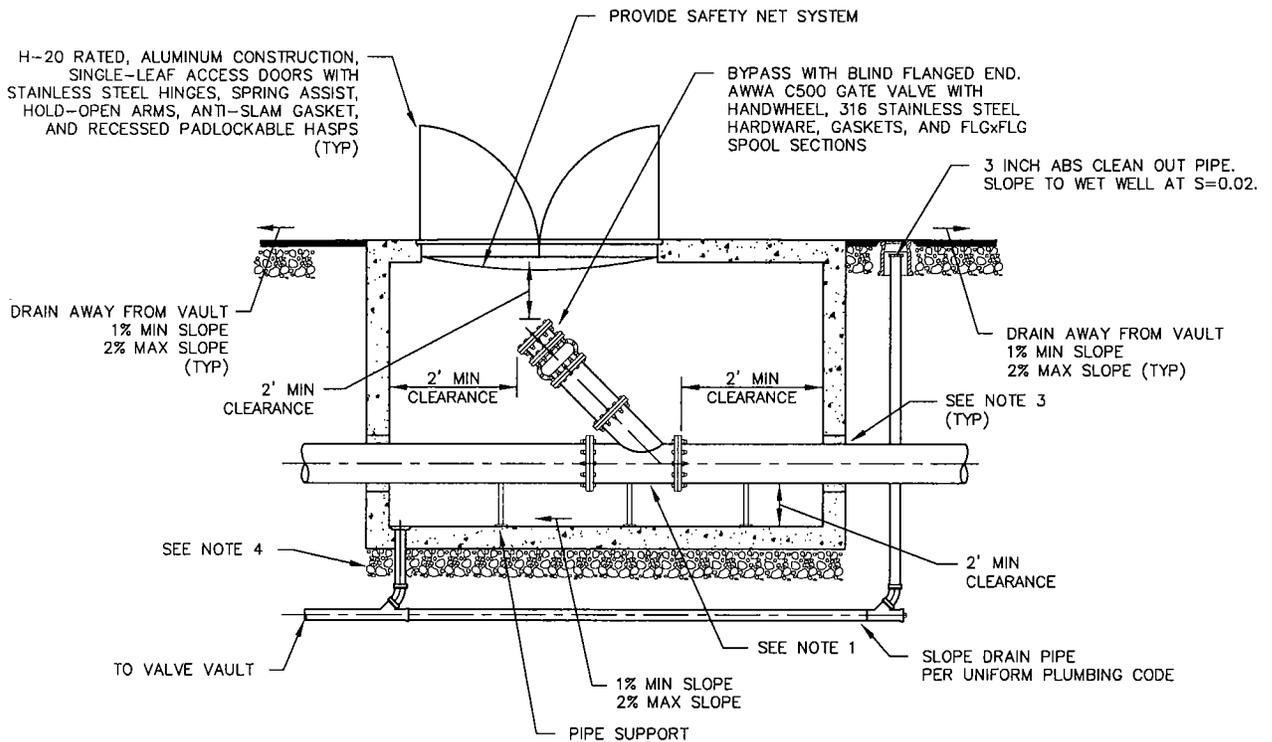

**SECTION**

**NOTES:**

1. AWWA C110 REDUCING WYE, FLGxFLGxFLG
2. 3 INCH  $\phi$  ABS DRAIN, LENGTH AS REQUIRED
3. NOTED PIPE PENETRATIONS SHALL BE BORED OR BLOCKED OUT AND SEALED WITH LINK SEAL OR APPROVED EQUAL. OPENINGS SHALL BE ADDITIONALLY REINFORCED PER STRUCTURAL DRAWINGS
4. AB THICKNESS SHALL BE PER GEOTECHNICAL RECOMMENDATION.

*Mary K Snyder*  
DIRECTOR

**SACRAMENTO COUNTY  
MUNICIPAL SERVICES AGENCY**

**BYPASS  
VAULT**

DRAWN BY: PL  
SCALE: NONE  
DATE: 11/07

**7-6M-40**