

NOTE:

ALL JOINTS ABOVE THE LEACHING AREA SHALL BE MORTAR SEALED INSIDE & OUT

24" ϕ C.I. GRATE & FRAME ALHAMBRA FOUNDRY #A-1200 OR APPROVED EQUAL. ADAPT AS REQUIRED FOR 1/2" GUTTER & CURB & GUTTER INSTALLATION; SET RIM TO GRADE WITH PRECAST RISERS

COMPACT BACKFILL TO 90% MIN. FLOODING & JETTING WILL NOT BE ALLOWED. (TOP 6" COMPACTED TO 95%)

48" ϕ PRECAST MANHOLE CONE

6" P.V.C. OR A.B.S. DOWN DRAIN

PRECAST CONC. SLAB


4" CONCRETE SLAB (POURED IN PLACE) SHALL EXTEND 6" INTO UNDISTURBED SOIL

48" PRECAST PERFORATED CONCRETE RING

3/8" TO 3/4" ϕ WASHED ROCK

NON-WOVEN FILTER FABRIC PER SEC. 88-103 CAL. STD. SPEC. DATE: 7-84

3/8" TO 3/4" ϕ WASHED ROCK ON UNDISTURBED SOIL

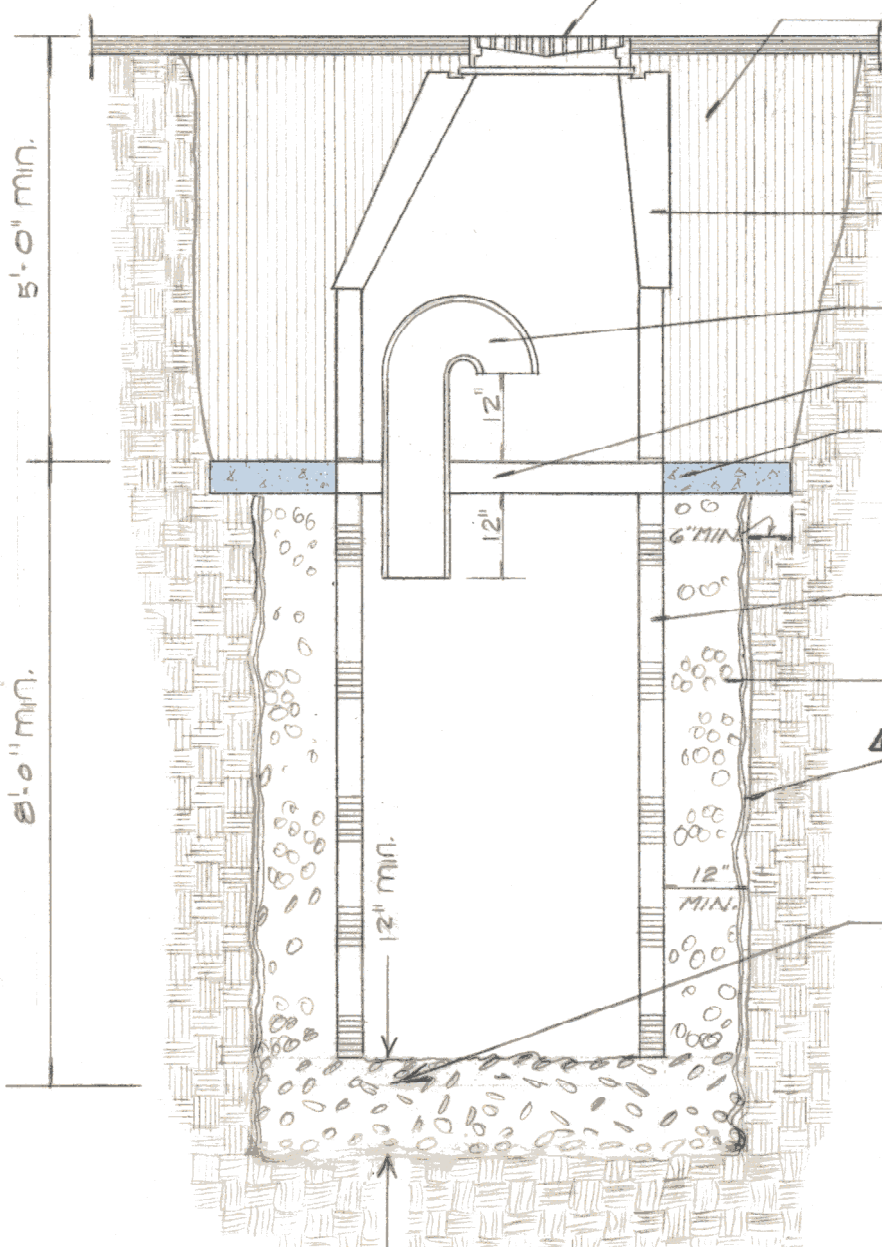

△ REV. #1 11-27-84

CITY OF INDIO		
DEPARTMENT OF PUBLIC WORKS		
STANDARD DRYWELL DETAIL		
DATE <u>3-10-81</u>	SCALE <u>NONE</u>	DWG. NO. <u>SS-301</u>
APPD. <u>[Signature]</u>	DWN BY <u>KE</u>	SHEET <u>1</u> OF <u>1</u>