


NOTES

1. ALL STEPS SHALL BE GALVANIZED AFTER FABRICATION. MINIMUM DIAMETER OF THE STEPS SHALL BE 3/4".
2. NO STEPS WILL BE REQUIRED WHEN HEIGHT IS 3'-6" OR LESS. ONE STEP 16" SHALL BE INSTALLED ABOVE THE FLOOR WHEN HEIGHT IS GREATER THAN 3'-6", BUT LESS THAN 5'-0". WHERE HEIGHT IS 5' OR MORE, STEPS SHALL BE SPACED EVENLY AT INTERVALS NOT TO EXCEED 12" FROM 16" ABOVE THE FLOOR TO WITHIN 12" OF THE TOP OF THE BOX. STEPS SHALL BE PLACED IN A WALL WITHOUT PIPE OPENINGS, AND ADJACENT TO THE MANHOLE.

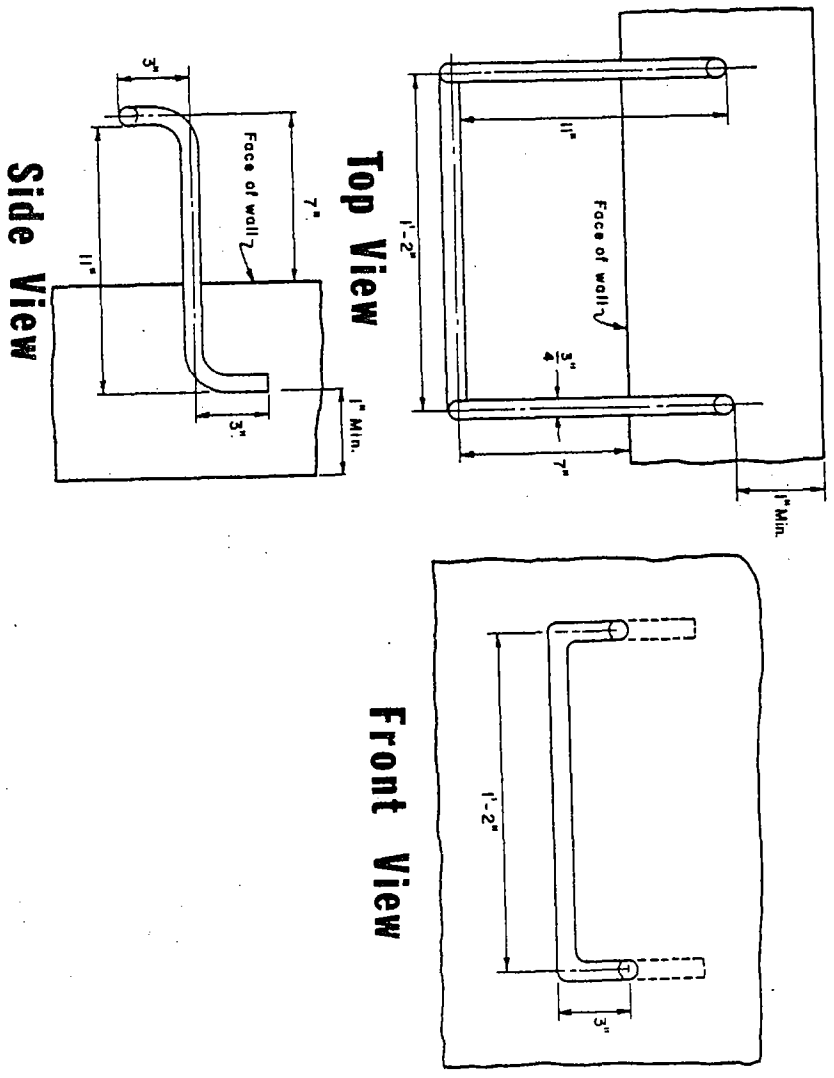

COUNTY OF SANTA BARBARA, CA. - DEPARTMENT OF PUBLIC WORKS - ROADS DIV.

Approved by

2-115

GALVANIZED STEEL STEP

Charles Wagner
DIRECTOR OF PUBLIC WORKS

4/1/87
DATE