



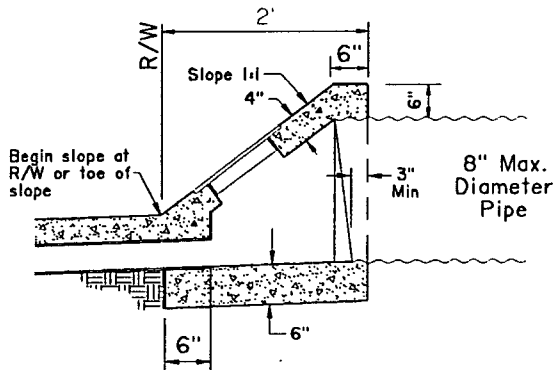


CASE I INLET
Pipe

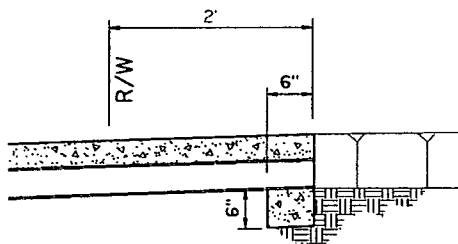


CASE II INLET
Open Ditch

NOTES

1. See Sheet 3 for details and notes.
2. Angle A = 75° Max., 40° Min.
3. Alhambra Foundry A-470 rectangular cast iron pipe may be substituted at the Contractor's option or as specified on the plans.
4. Cast iron facilities shall have a bituminous coating conforming to AASHTO Designation: M190.
5. P.V.C. pipe shall be minimum Schedule 40 or better.
6. Concrete Class = 560-C-3250, 1" rock, 4" max. slump.

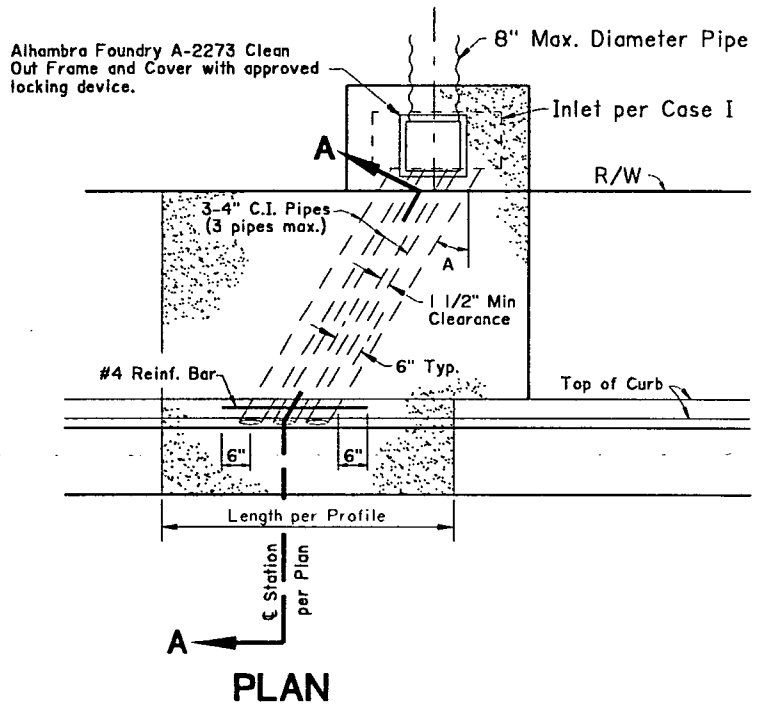


PLAN

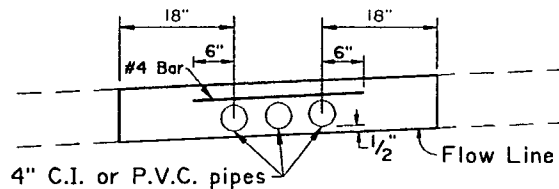


PROFILE

8" Normal Curb Face

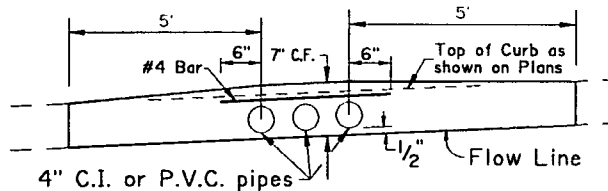

PROFILE

6" Normal Curb Face

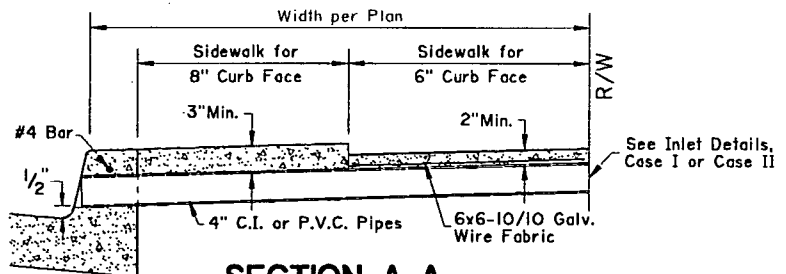

SECTION A-A

REVISED DATE _____ _____ _____ _____ _____	CITY OF FULLERTON ENGINEERING DEPARTMENT		DRAWN <u>PLS.</u> DATE <u>8/1/95</u>
	PARKWAY CULVERT - TYPE "B"		STD. NO. 128 2 of 3
	APPROVED <i>Robert Hudson</i> DATE <u>8/16/95</u> DIRECTOR OF ENGINEERING		