


**NOTE:**  
POST LOCATED TO ALLOW  
NOZZLE ACCESS

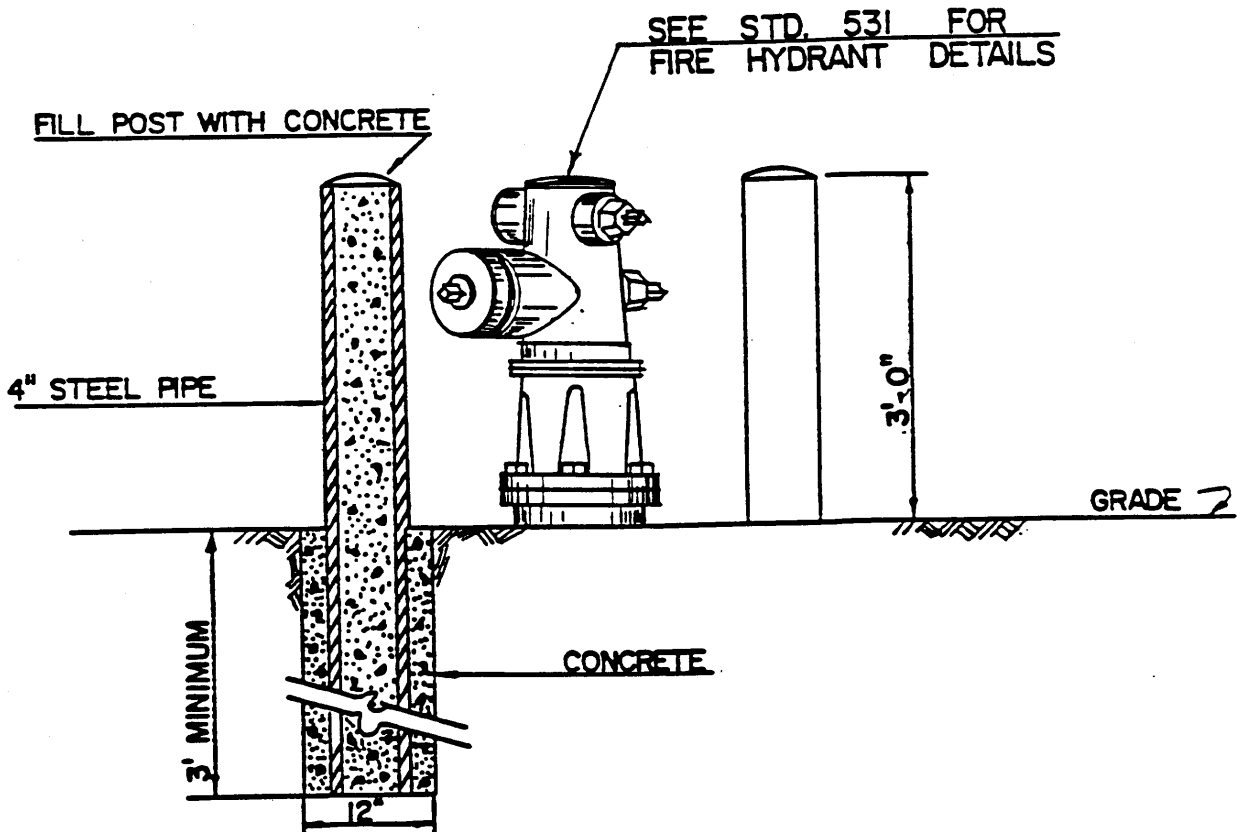

THE FIRE HYDRANT GUARD POST SHALL RECEIVE ONE PRIMER COATING OF NO. 5210 YELLOW CHROMATE PRIMER FOLLOWED BY ONE COAT OF NO. 5176 CORROSION INHIBITIVE RED PRIMER AS MANUFACTURED BY GILMORE NOLAN OR APPROVED EQUAL. FINISH PAINT SHALL BE TWO COATS RUSTLESS INDUSTRIAL NO. 2420 FIRE HYDRANT CHROME YELLOW PAINT OR APPROVED EQUAL.

CITY OF BUENA PARK DEPARTMENT OF PUBLIC WORKS	Approved <u>Donald K. Jensen</u> 5/27/87 City Engineer Date	STD 527
<b>FIRE HYDRANT GUARD POST INSTALLATION</b>		